



Section C-C

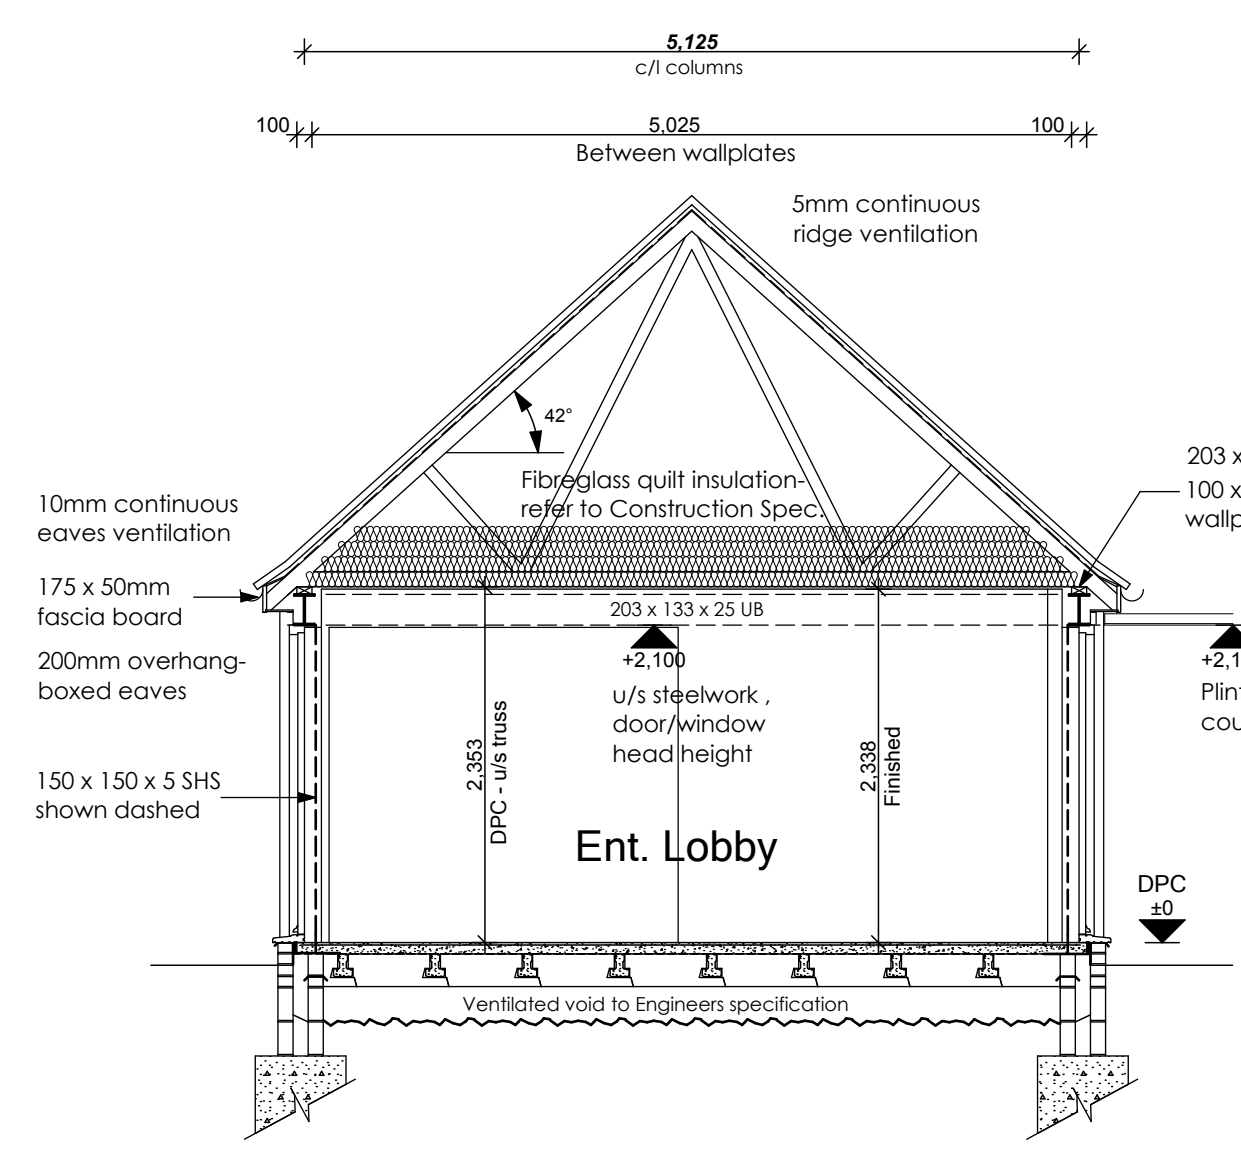


Section D-D

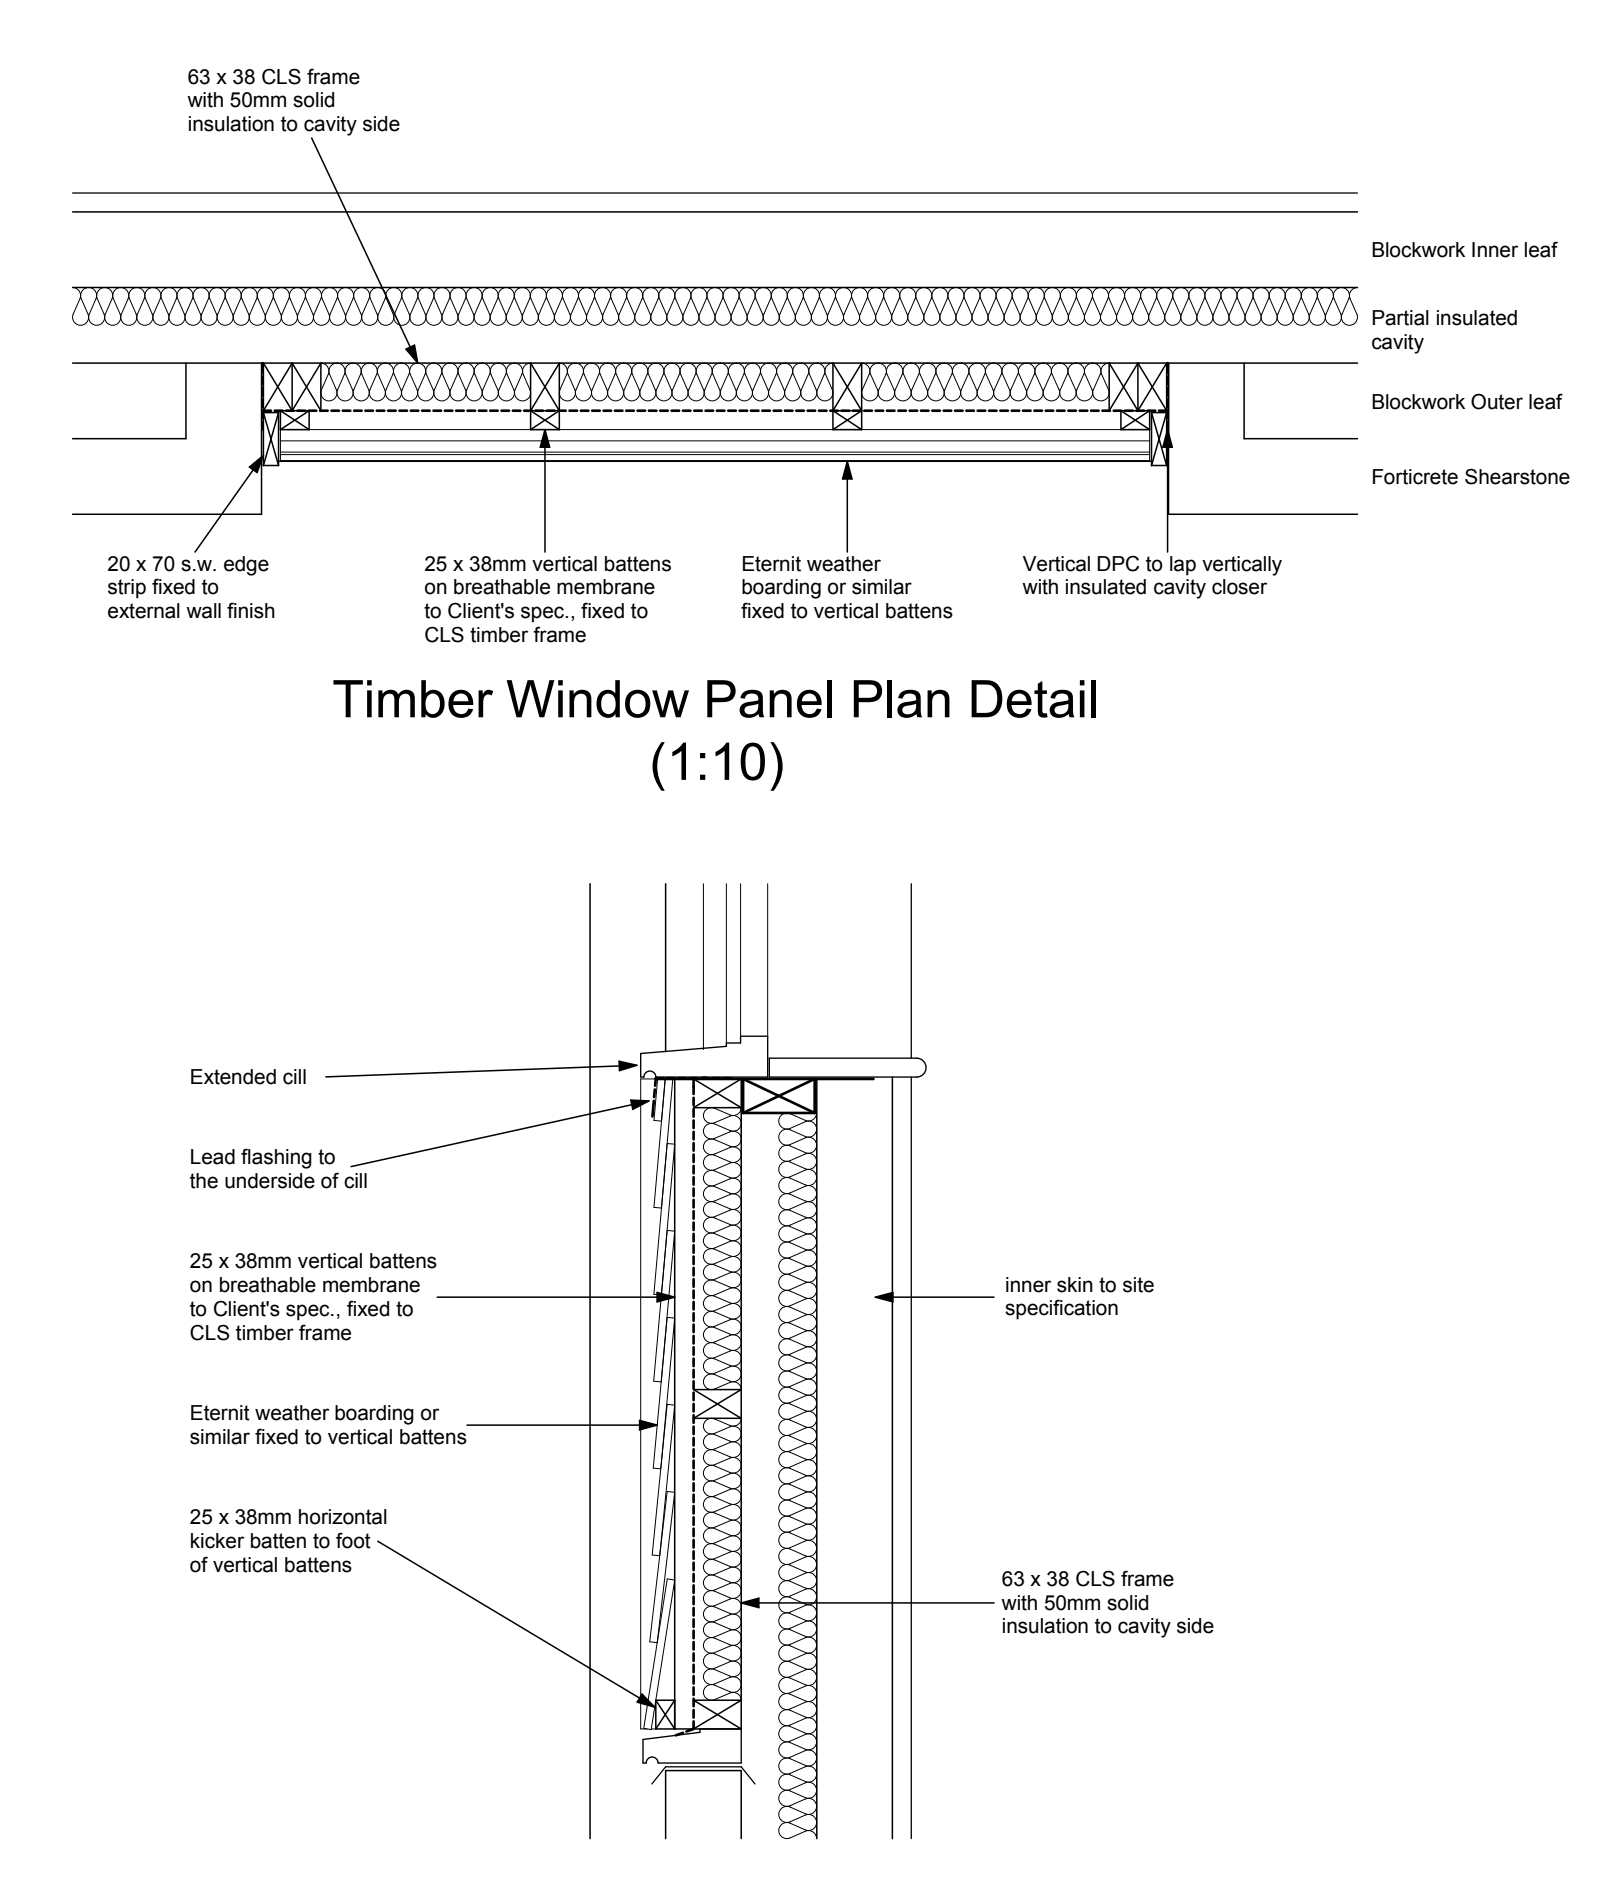


Timber Window Panel Plan Detail (1:10)

Timber Window Panel Section Detail (1:10)

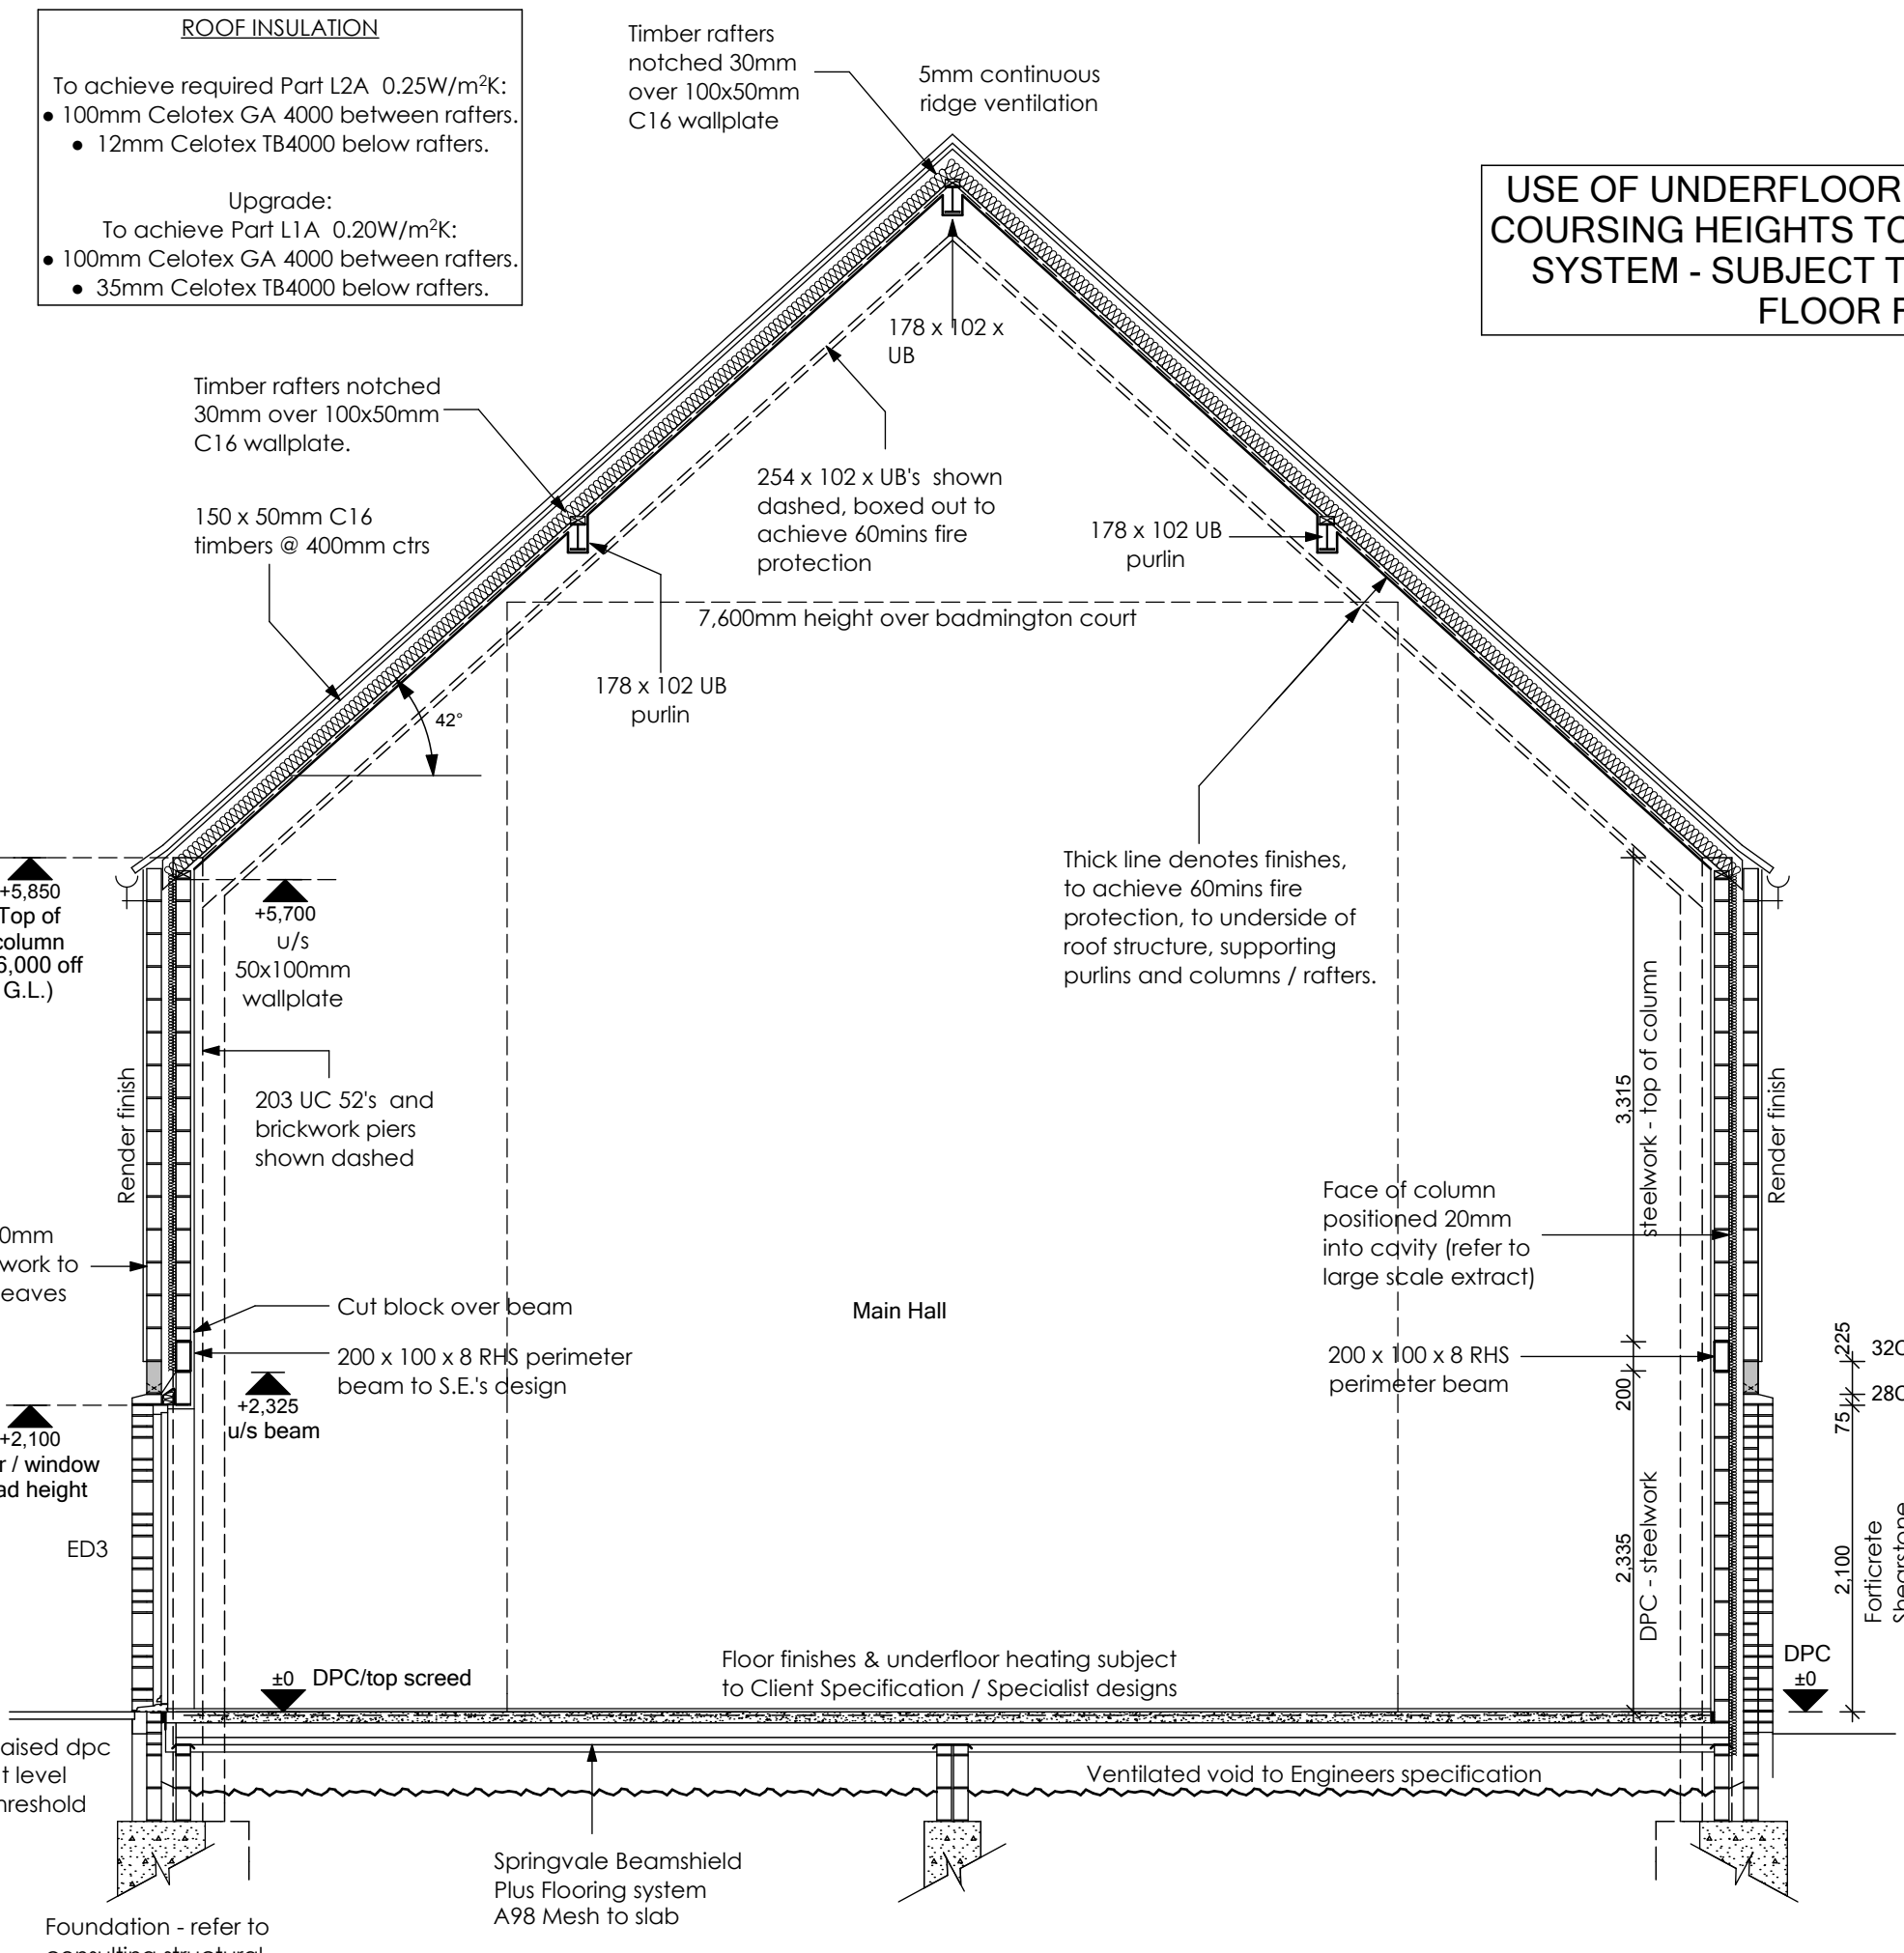

Section A-A


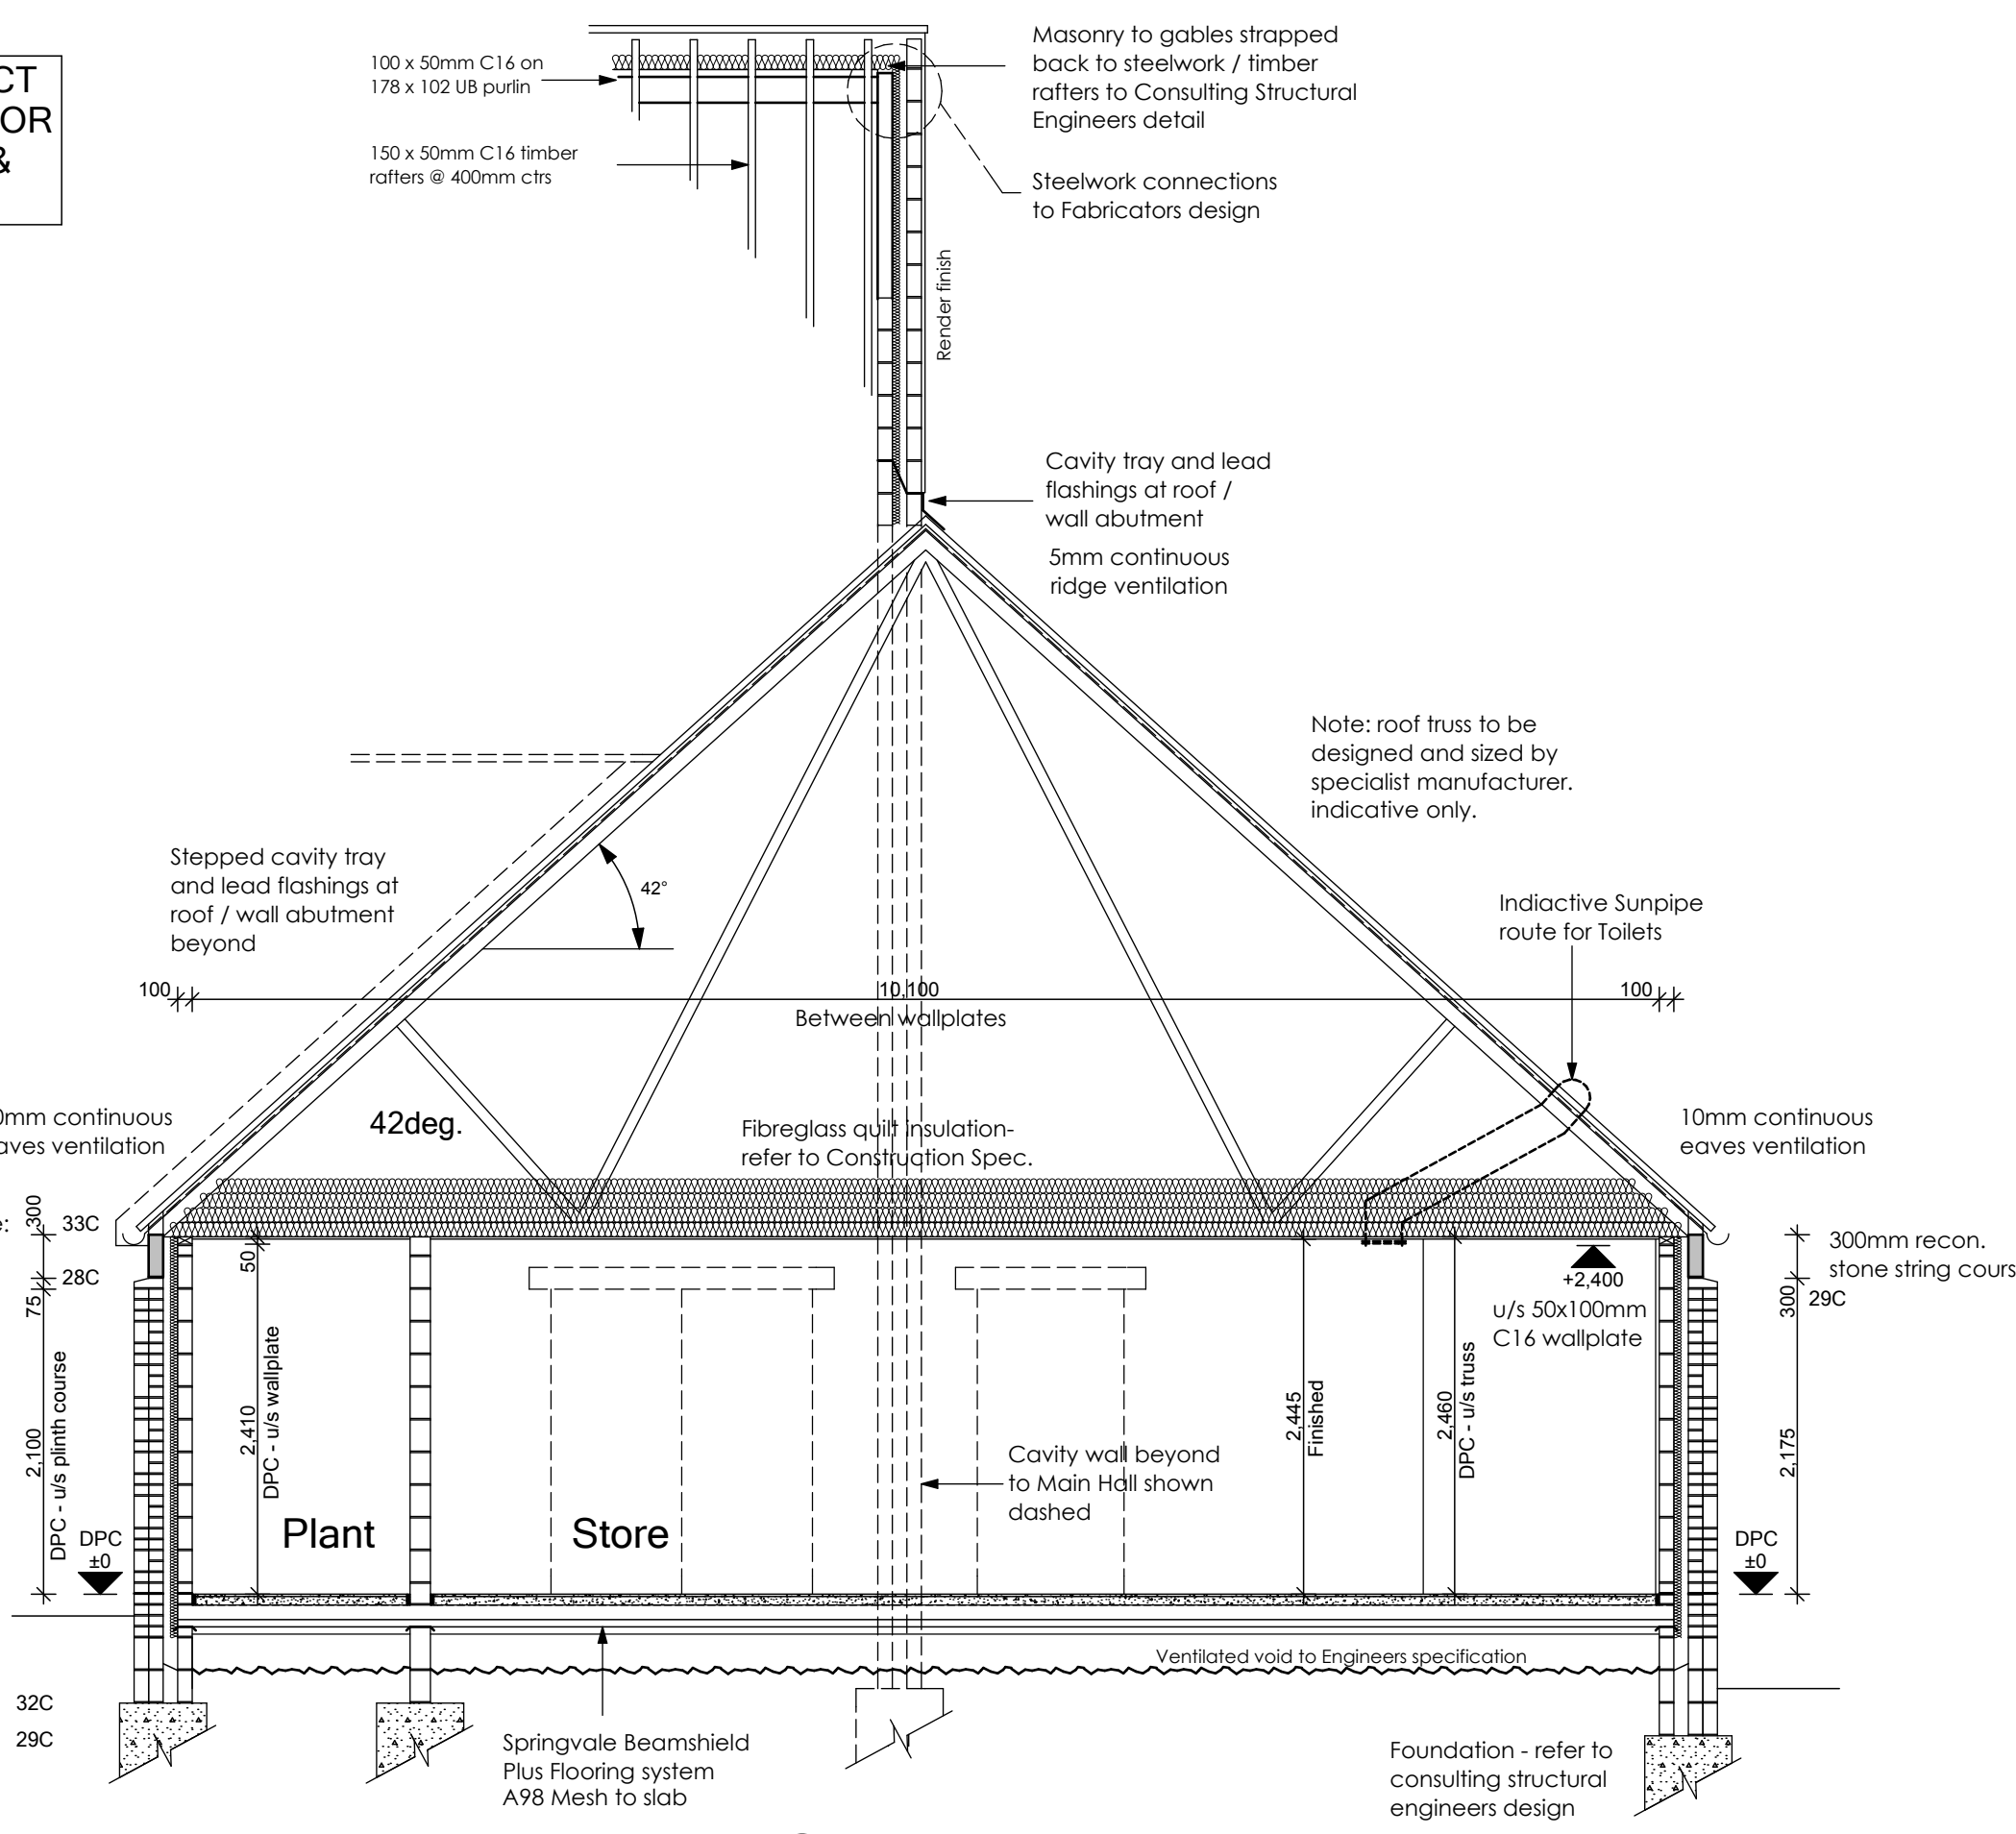


Section B-B

USE OF UNDERFLOOR HEATING MAY AFFECT COURSE HEIGHTS TO BEAM & BLOCK FLOOR SYSTEM - SUBJECT TO SYSTEM DESIGN & FLOOR FINISHES

ROOF INSULATION
To achieve required Part L2A 0.25W/m²K:
• 100mm Celotex GA 4000 between rafters.
• 12mm Celotex TB4000 below rafters.

Upgrade:
To achieve Part L1A 0.20W/m²K:
• 100mm Celotex GA 4000 between rafters.
• 35mm Celotex TB4000 below rafters.

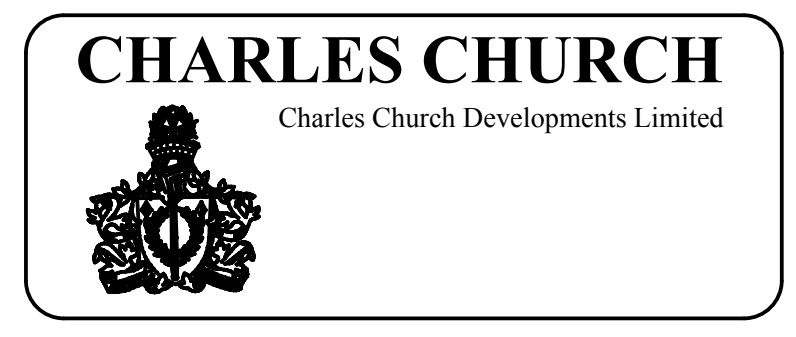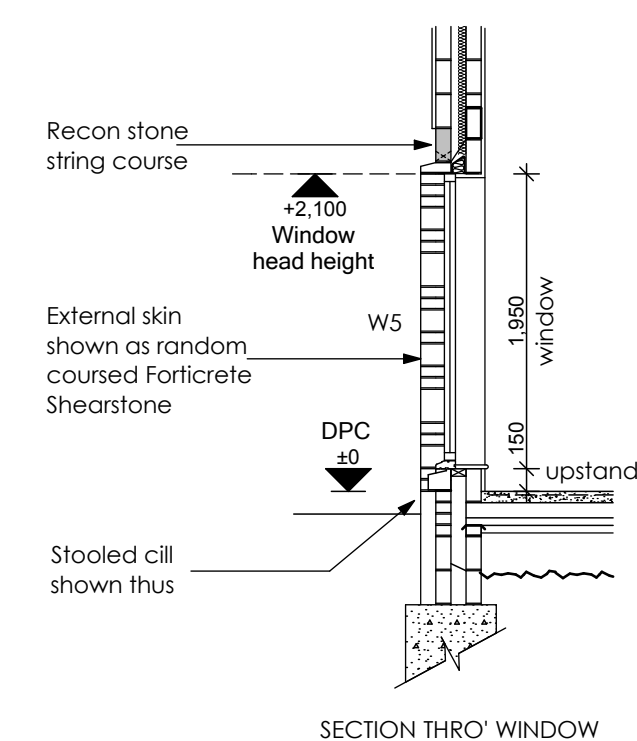

THE PADDOCKS, COX'S LANE, ENSTONE

VILLAGE HALL SECTIONS

Date: April 2012
PAPER SIZE: A1 Scale: 1:50

Drawing No: 065 - VH - WKG_04
Rev: T2